


UL. HENRYKA SIENKIEWICZA

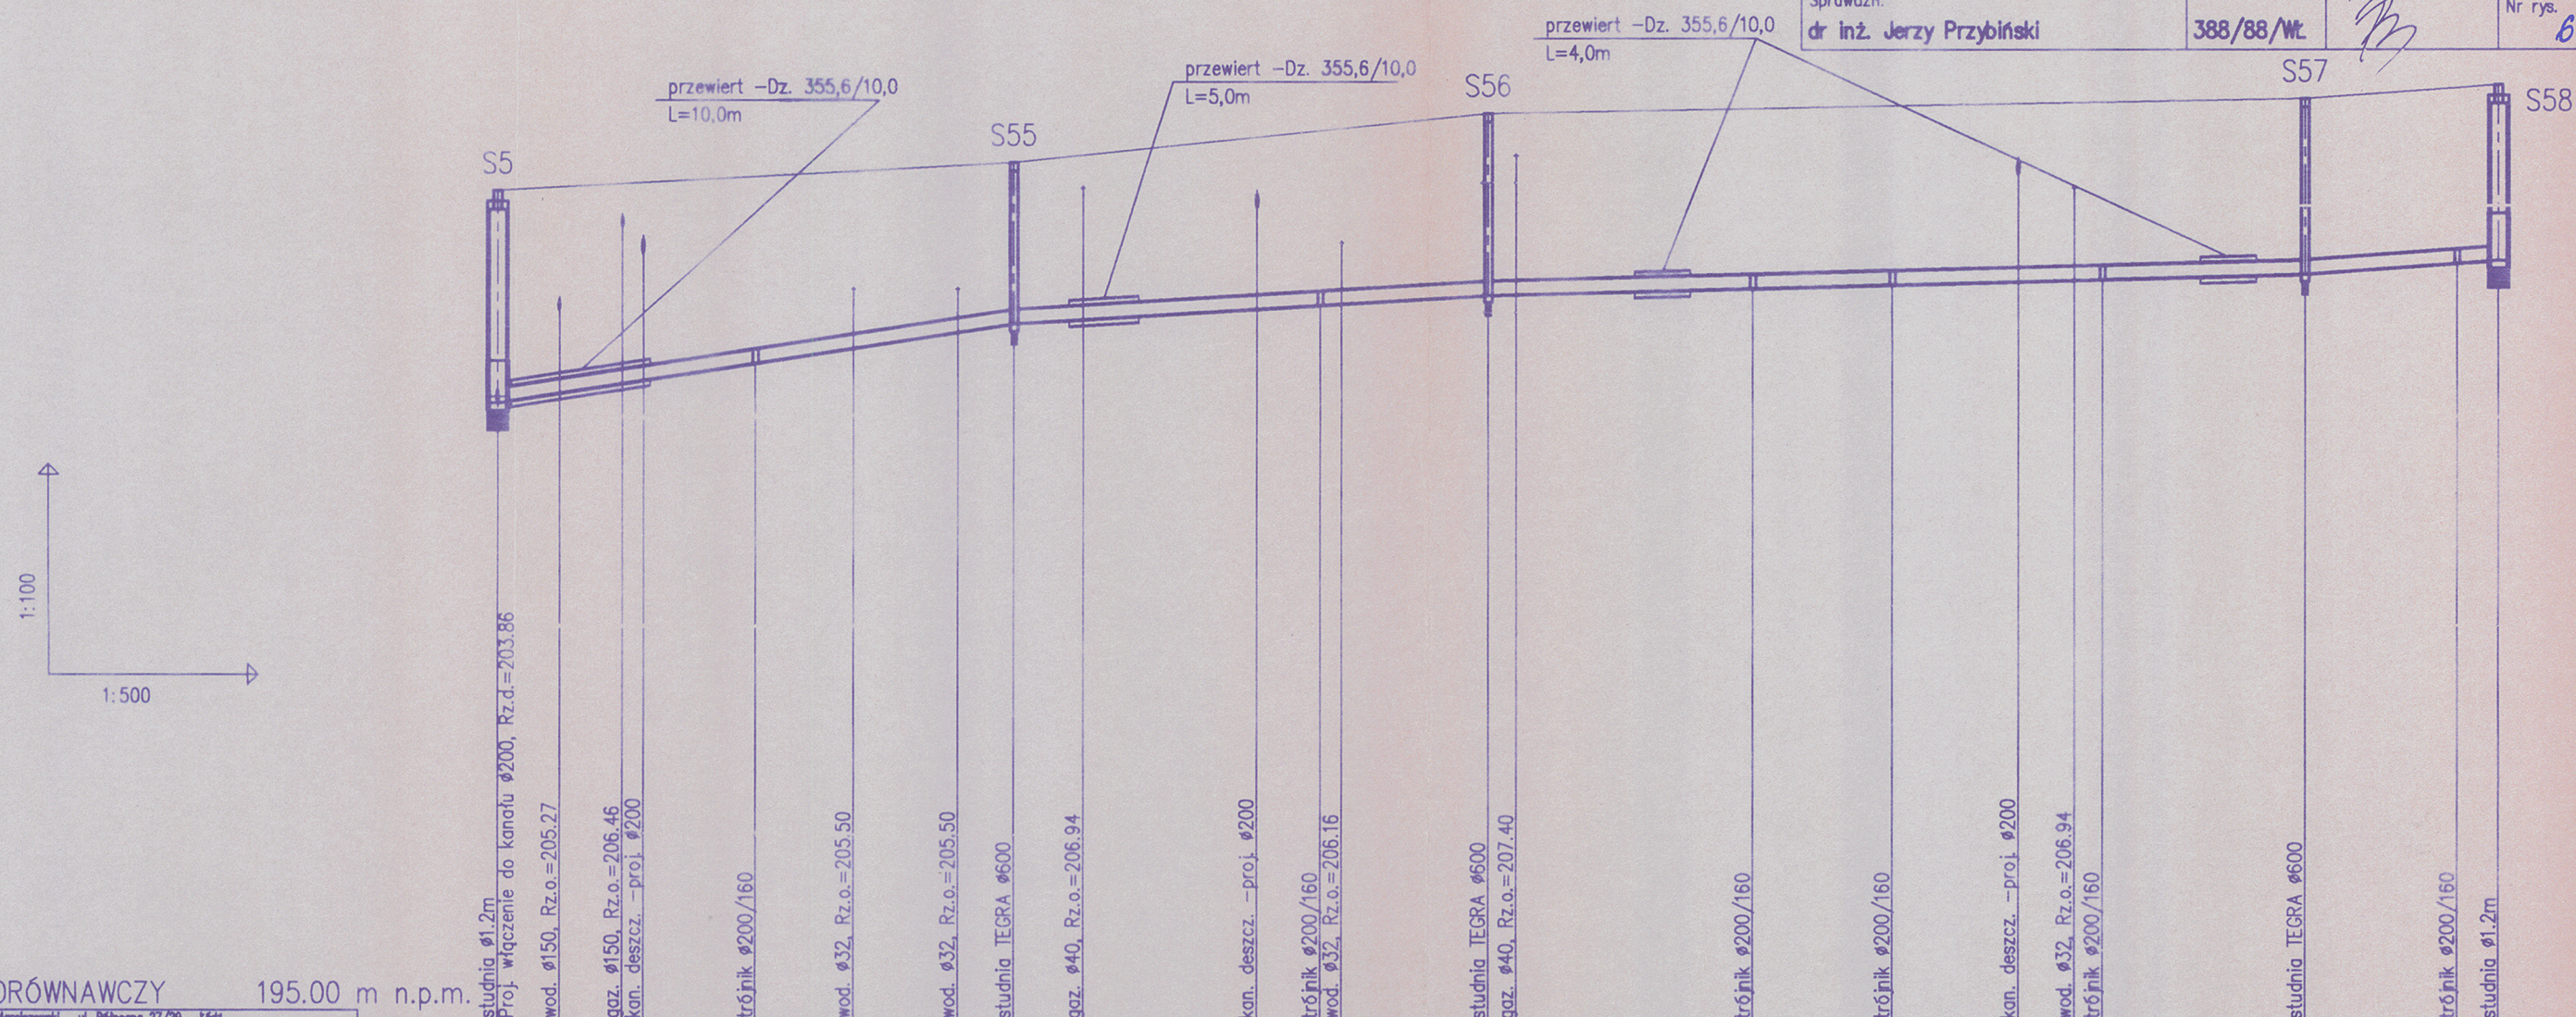

POZIOM PORÓWNAWCZY		195.00 m n.p.m.																																
Zakład Proj. "KOMI" W. Marczewski ul. Piłsudskiego 27/28 76-641		studni Proj.	wod. wod.	gaz. kan. d	kan. d	trójnik wod. g	wod. g	gaz. g	kan. d	trójnik wod. g	studni gaz.	gaz. g	trójnik wod. g	kan. d	wod. wod.	trójnik wod. g	studni	trójnik wod. g	studni															
RZĘDNA TERENU ISTN.		206.90				207.0					207.30			207.75			208.00		208.06		208.10			208.15			208.20			208.36		208.40		208.40
RZĘDNA DNA KANAŁU		203.86 203.87	204.01	204.15 204.19		204.44		204.65		204.88	205.00	205.06		205.21	205.26 205.28		205.41 205.42		205.50		205.55		205.60	205.62 205.63			205.70			205.86		205.90		205.90
ZAGŁĘBIENIE DNA KANAŁU		3.04 3.03				2.66					2.30				2.49		2.59		2.56		2.55			2.52			2.50			2.50		2.50		2.50
SPADKI, DŁUGOŚCI		30.5 ‰								12 ‰				5 ‰								14 ‰												
		37.00m								34.00m								58.50m				14.00m												
ŚREDNICA, MATERIAŁ		ø200 PVC "S" L=143.50m																																
ODLEGŁOŚCI		0.00	4.50	9.00 10.50	18.50	18.50	25.50	18.50	33.00	37.00	42.00	22.00	54.50	59.00 60.50	12.00	71.00 73.00	19.00	90.00	10.00	100.00	15.00	109.00	113.00 115.00	14.50	129.50	11.00	140.50	143.50	3.00					
HEKTOMETRY		S5			I4/				S55				T48		S56		T49		T50		T50c		S57			T51		S58						
EPI-Grat. Generator rysunkowy 7.0		